



Comparison – BOSS & UPS



Conventional AC

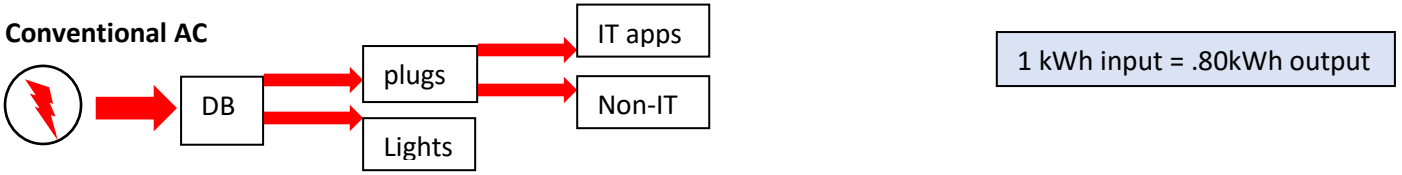

With conventional Backup

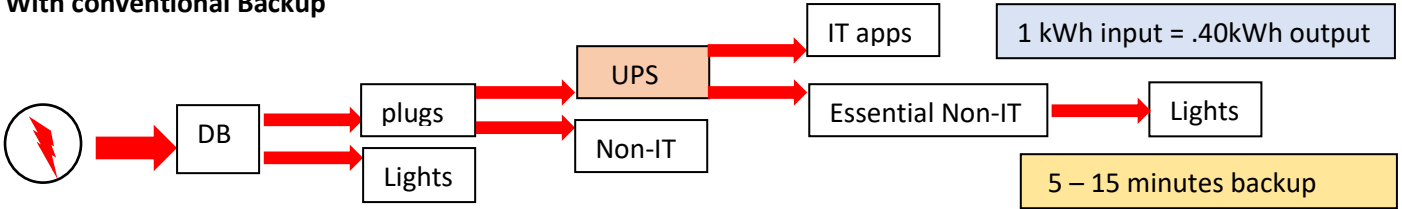


Extended conventional backup

Backup genset option added to above layout, supplying DB when mains supply fails..... @fivefold cost/kwh

Backup is fuel dependent


BossEnergy conventional

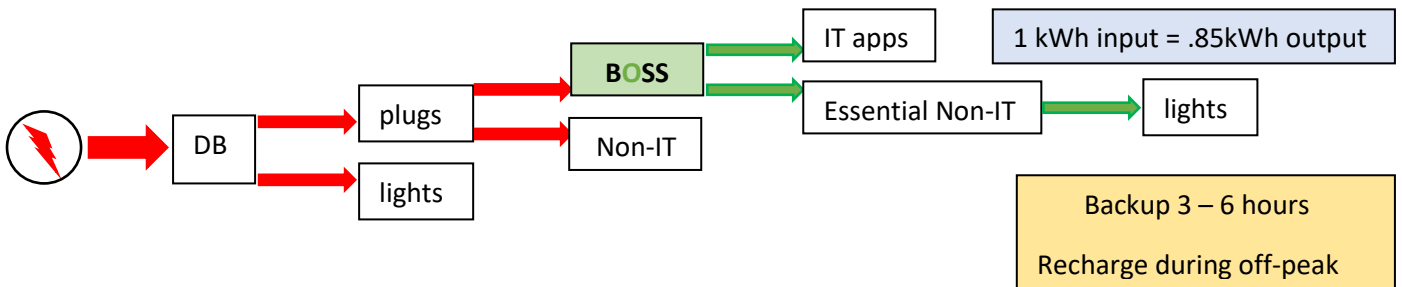

BossEnergy extended

Backup genset as above..... or Solar PV array to take installation off-grid at cost of R15,000 – R25,000/kw

UPS, BOSS direct efficiency comparison

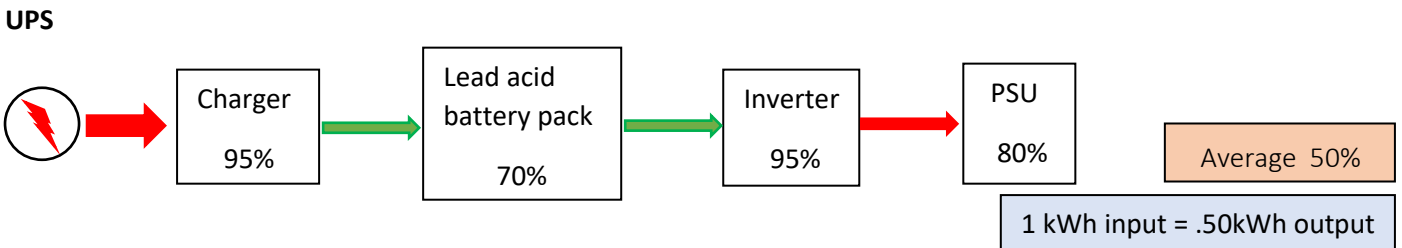

BOSSpack

